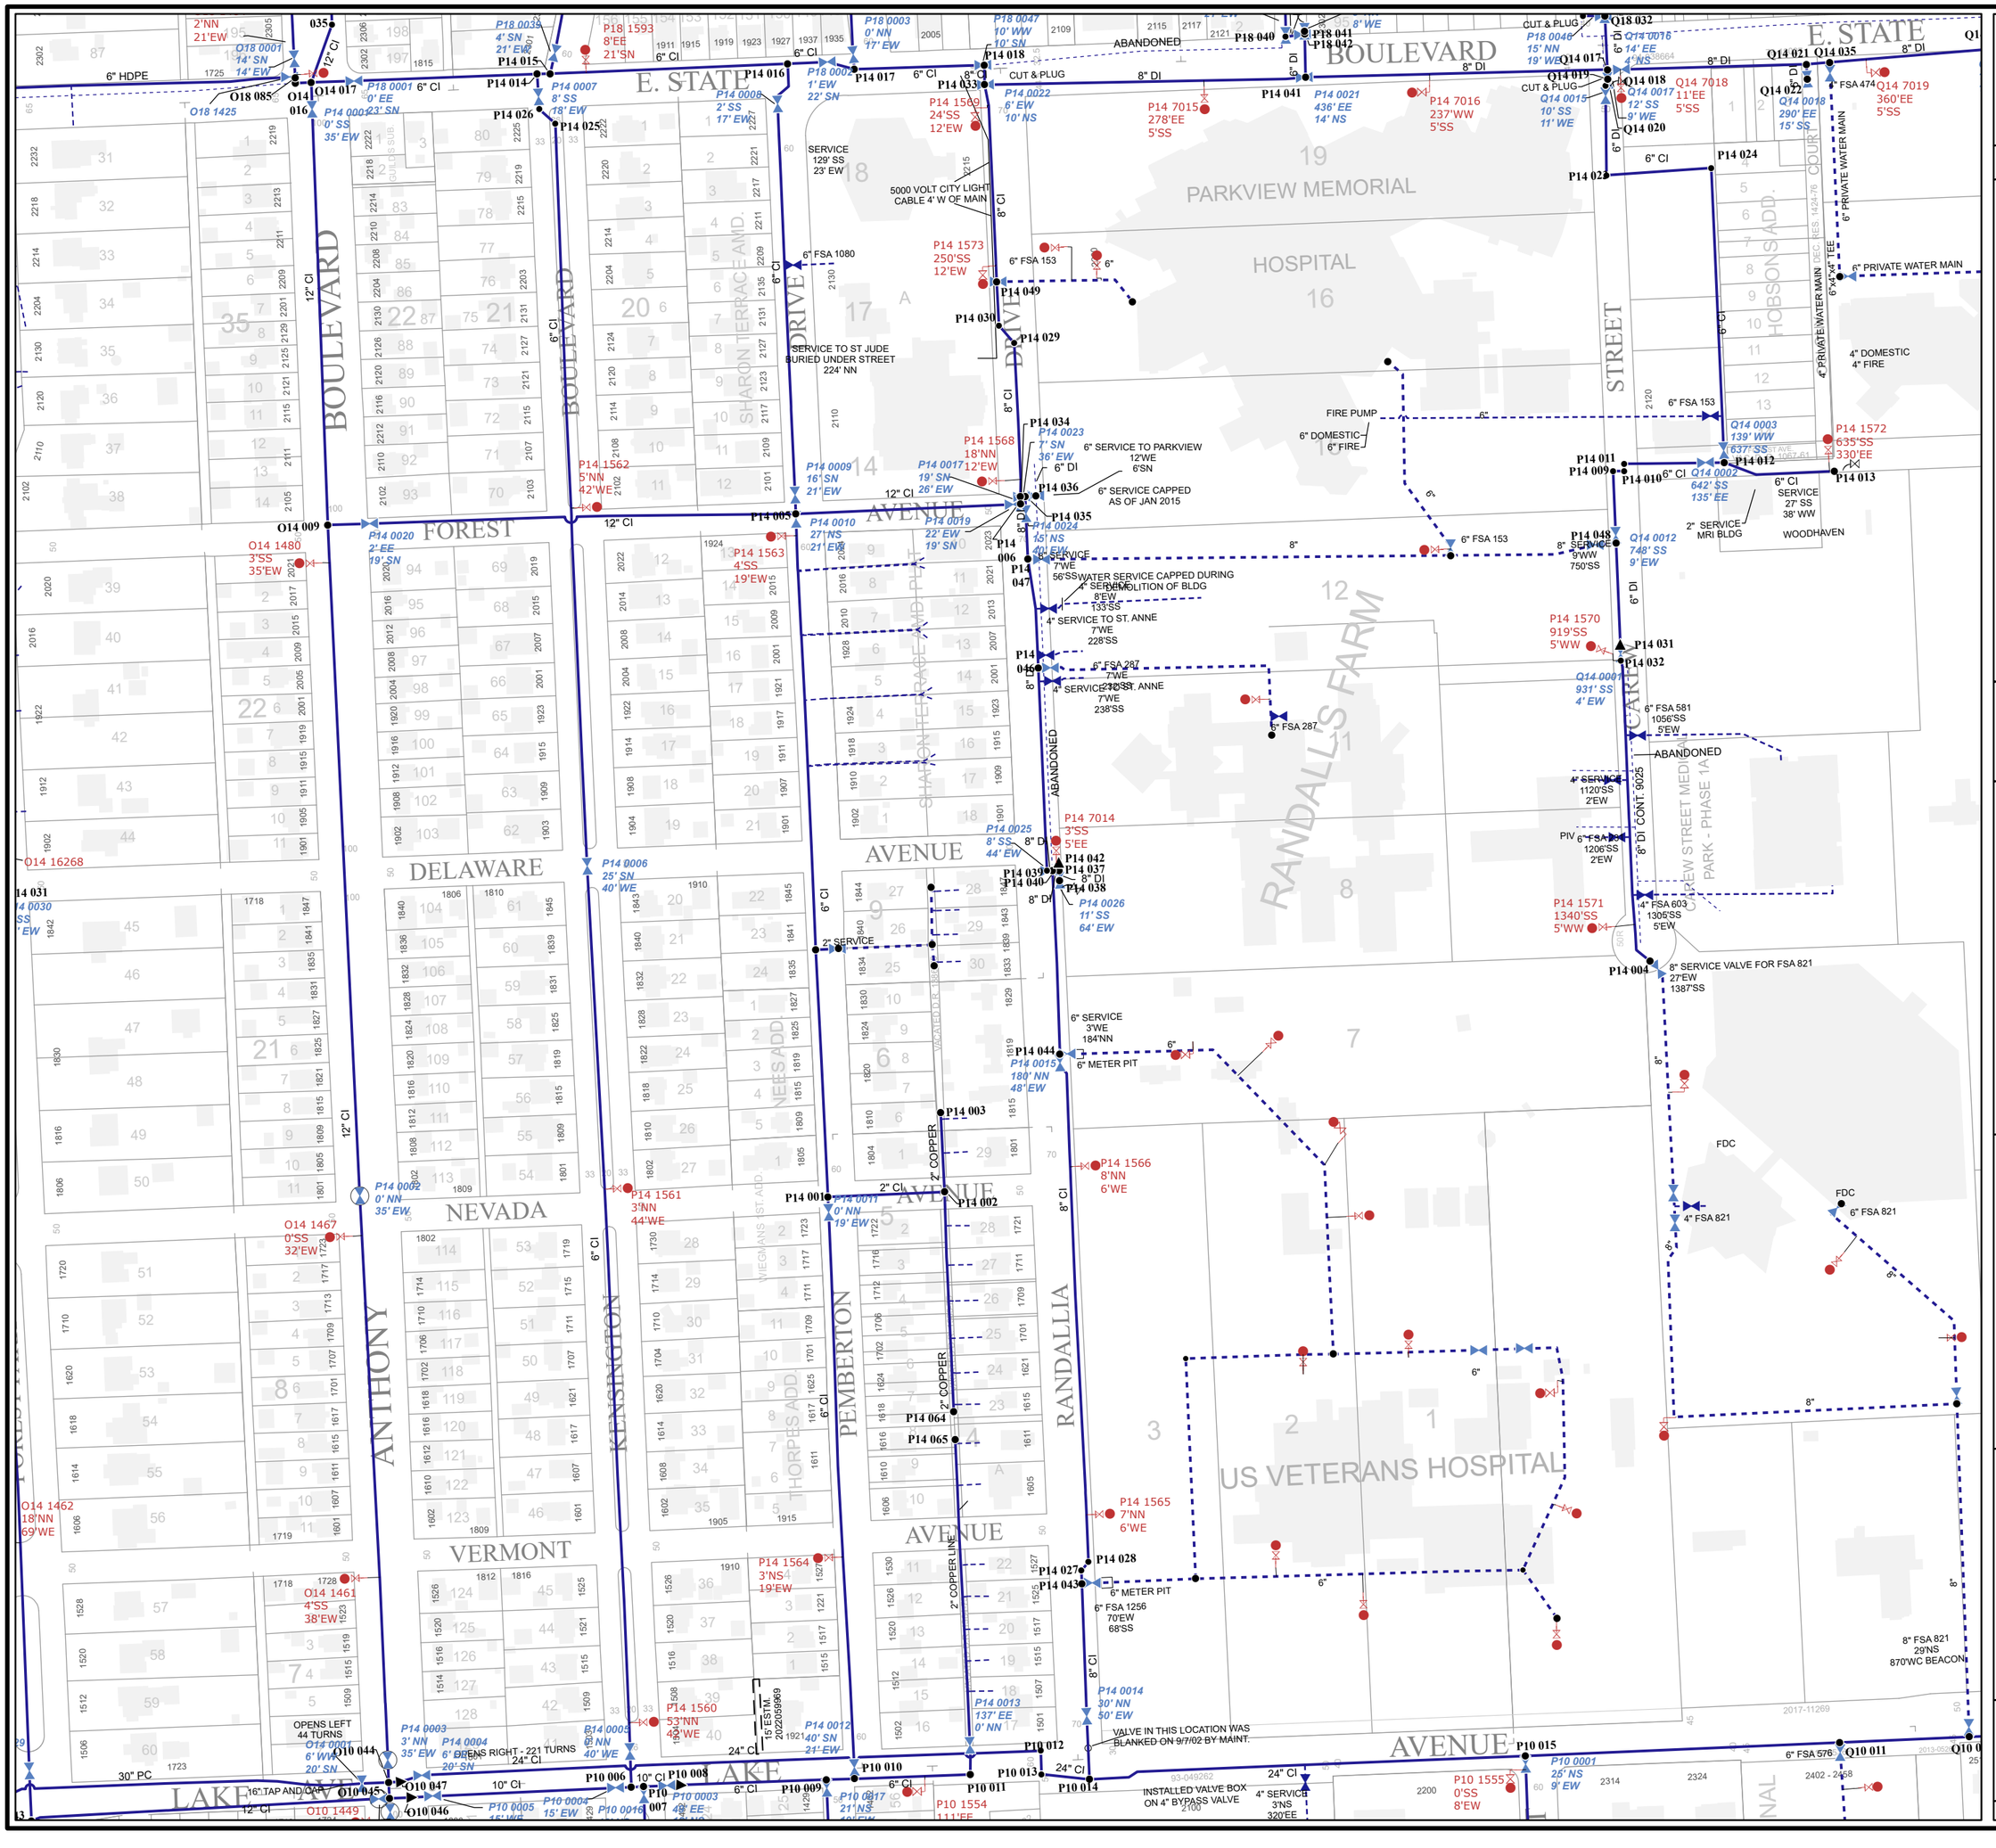
E. STATE BOULEVARD
BOULEVARD
DRIVE
AVENUE
FOREST
DELAWARE
LAKE AVENUE
NEVADA
VERMONT
ANTHONY
KENSINGTON
PEMBERTON
RANDALLIA
HOBSONS ADD.
PARKVIEW MEMORIAL HOSPITAL
US VETERANS HOSPITAL
RANDALL'S FARM
SHARON TERRACE AMD. PLT
ABANDONED
6" HDPE
12" CI
6" CI
8" CI
8" DI
6" DI
2" COPPER
2" SERVICE
6" SERVICE 3'WE 184'NN
6" METER PIT
6" FSA 1256 70'EW 68'SS
6" FSA 153
6" FSA 287
6" FSA 581 1056'SS 5'EW
6" FSA 576
6" FSA 1080
4" FSA 603 1305'SS 5'EW
4" FSA 474
4" FSA 821
6" FSA 821
8" FSA 821 29'NS 870'WC BEACON
FIRE PUMP
6" DOMESTIC
6" FIRE
4" DOMESTIC
4" FIRE
6" PRIVATE WATER MAIN
4" PRIVATE WATER MAIN
6" SERVICE TO PARKVIEW 12'WE 6'SN
6" SERVICE CAPPED AS OF JAN 2015
SERVICE TO ST JUDE BURIED UNDER STREET 224' NN
5000 VOLT CITY LIGHT CABLE 4' W OF MAIN
WATER SERVICE CAPPED DURING DEMOLITION OF BLDG
4" SERVICE TO ST. ANNE
4" SERVICE 7'WE 56'SS
8" SERVICE 9'WW 750'SS
4" SERVICE 1120'SS 2'EW
6" SERVICE 27' SS 38' WW WOODHAVEN
2" SERVICE MRI BLDG
6" SERVICE 3'WE 184'NN
8" SERVICE VALVE FOR FSA 821 27'EW 1387'SS
INSTALLED VALVE BOX ON 4" BYPASS VALVE
4" SERVICE 3'NS 320'EE
VALVE IN THIS LOCATION WAS BLANKED ON 9/7/02 BY MAINT.
CUT & PLUG
P14 018
P14 033
P14 049
P14 030
P14 029
P14 034
P14 036
P14 035
P14 048
P14 011
P14 009
P14 010
P14 012
P14 013
P14 031
P14 032
P14 004
P14 044
P14 003
P14 001
P14 002
P14 064
P14 065
P14 028
P14 027
P14 043
P14 042
P14 037
P14 039
P14 040
P14 038
P14 041
P14 022
P14 024
P14 026
P14 025
P14 016
P14 017
P14 014
P14 015
P14 005
P14 006
P14 047
P14 045
P10 012
P10 013
P10 014
P10 015
P10 010
P10 011
P10 009
P10 008
P10 007
P10 006
P10 044
P10 045
P10 047
P10 046
O14 009
O14 016
O14 017
O14 085
O18 1425
O14 1480 3'SS 35'EW
O14 16268
O14 1467 0'SS 32'EW
O14 1462 18'NN 69'WE
O14 1461 4'SS 38'EW
O14 1449
P14 1573 250'SS 12'EW
P14 1569 24'SS 12'EW
P14 1568 18'NN 12'EW
P14 1562 5'NN 42'WE
P14 1563 4'SS 19'EW
P14 1561 3'NN 44'WE
P14 1560 53'NN 40'WE
P14 1564 3'NS 19'EW
P14 1566 8'NN 6'WE
P14 1565 7'NN 6'WE
P14 1572 635'SS 330'EE
P14 1570 919'SS 5'WW
P14 1571 1340'SS 5'WW
P14 7014 3'SS 5'EE
P14 7015 278'EE 5'SS
P14 7016 237'WW 5'SS
P14 7018 11'EE 5'SS
P14 7019 360'EE 5'SS
P14 1593 8'EE 21'SN
P14 0021 436' EE 14' NS
P14 0022 6' EW 10' NS
P14 0026 11' SS 64' EW
P14 0025 8' SS 44' EW
P14 0017 19' SN 26' EW
P14 0019 22' EW 19' SN
P14 0023 7' SN 36' EW
P14 0024 15' NS 40' EW
P14 0010 27' NS 21' EW
P14 0009 16' SN 21' EW
P14 0008 2' SS 17' EW
P14 0007 8' SS 18' EW
P14 0006 25' SN 40' WE
P14 0005 NN 40' WE
P14 0004 15' EW
P14 0003 3' NN 35' EW
P14 0002 0' NN 35' EW
P14 0001 0' EE 23' SN
P14 0020 2' EE 19' SN
P14 0018 290' EE 15' SS
P14 0016 14' EE 4' NS
P14 0015 180' NN 48' EW
P14 0014 30' NN 50' EW
P14 0013 137' EE 0' NN
P14 0012 40' SN 21' EW
P14 0011 0' NN 19' EW
P14 0017 21' NS
P18 0039 4' SN 21' EW
P18 0003 0' NN 77' EW
P18 0047 10' WW 10' SN
P18 0002 1' EW 22' SN
P18 0046 15' NN 19' WE
P18 0045 8' WE
P18 040
P18 041
P18 042
Q14 017
Q14 018
Q14 019
Q14 020
Q14 021
Q14 035
Q14 022
Q14 0015 10' SS 11' WE
Q14 0017 12' SS 9' WE
Q14 0018 290' EE 15' SS
Q14 0003 139' WW 637' SS
Q14 0002 642' SS 135' EE
Q14 0012 748' SS 9' EW
Q14 0001 931' SS 4' EW
Q18 032
Q18 0001 14' SN 14' EW
Q18 0046 15' NN 19' WE
P10 0001 25' NS 9' EW
P10 1555 0'SS 8'EW
P10 1554 111'EE
P10 0017 21' NS
P10 0003 40' EE
P10 0004 15' EW
P10 0005 15' WE
P10 0016
P10 0014
P10 0015
P10 0012
P10 0013
P10 0011
P10 0010
P10 0009
P10 0008
P10 0007
P10 0006
P10 0004
P10 0005
P10 0003
P10 0002
P10 0001
P10 0000
P10 0017
P10 0016
P10 0015
P10 0014
P10 0013
P10 0012
P10 0011
P10 0010
P10 0009
P10 0008
P10 0007
P10 0006
P10 0005
P10 0004
P10 0003
P10 0002
P10 0001
P10 0000
OPENS LEFT 44 TURNS
OPENS RIGHT - 221 TURNS
16" TAP AND CAP
30" PC
24" CI
10" CI
12" CI
16" TEST NO. 20220599
SERVICE 129' SS 23' EW
SERVICE 27' SS 38' WW
SERVICE 3'WE 184'NN
SERVICE 3'NS 320'EE
SERVICE 1120'SS 2'EW
SERVICE 9'WW 750'SS
SERVICE 7'WE 56'SS
SERVICE 7'WE 228'SS
SERVICE 7'WE 238'SS
SERVICE 8'EW 133'SS
SERVICE 27'EW 1387'SS
SERVICE 6'WE 184'NN